


1 Description

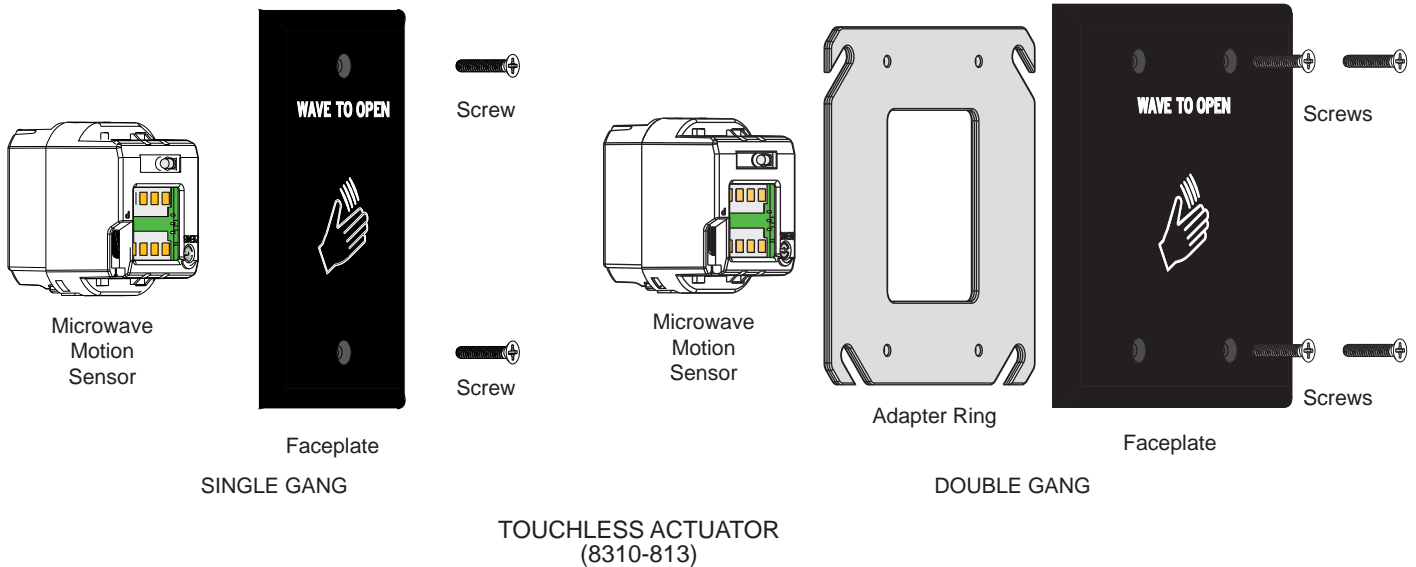

2 Specifications

| DESCRIPTION | SPECIFICATION |
|---|---|
| Technology | Microwave motion sensor |
| Radiated Frequency | 24.125 GHz |
| Radiated Power Density | 5 mW/cm ² |
| Supply voltage | 12 to 24VAC ± 10% 12 to 24VDC +30% / -10% |
| Supply Frequency | 50 to 60Hz |
| Power Consumption | < 1.5W |
| Output Relay contact rating (max voltage) Relay contact rating (max current) Max switching power | Relay with switch-over contact (voltage free) 60 VDC/ 125 VAC 1A (resistive) 30W (DC)/ 60VA (AC) |
| Detection Range | 4" to 24" (adjustable) |
| Detection Mode | Motion (bidirectional) |
| Output Hold Time | 0.5s (in pulsed mode) |
| Temperature Range | -4°F to + 131°F |
| Immunity | Immune to electrical and radio frequency interference |
| Weight | 0.34 lbs. |
| Material | ASA, Nylon, PC |
| Certification | Electromagnetic compatibility (EMC) according to 2004/108/EC FCC: G9B-MS08 IC: 4680A-MS08 |

3 Precautions



CAUTION



- ❑ Shut off all power going to wall outlet before attempting any wiring procedures.
- ❑ Maintain a clean & safe environment when working in public areas.
- ❑ Constantly be aware of pedestrian traffic around the door area.
- ❑ Always stop pedestrian traffic through the doorway when performing tests that may result in unexpected reactions by the door.
- ❑ ESD electrostatic discharge: Circuit boards are vulnerable to damage by electrostatic discharge. Before handling any board ensure you dissipate your body's charge.
- ❑ Always check placement of all wiring before powering up to insure that moving door parts will not catch any wires and cause damage to equipment.
- ❑ Ensure compliance with all applicable safety standards (i.e. ANSI A156.10 / A156.19) upon completion of installation.
- ❑ DO NOT attempt any internal repair of the sensor. All repairs and/or component replacements must be performed by LCN, Inc. Unauthorized disassembly or repair:
 1. May jeopardize personal safety and may expose one to the risk of electrical shock.
 2. May adversely affect the safe and reliable performance of the product will result in a voided product warranty.

4 Pre-Installation Check

1. When wiring multiple devices together creating a system configuration, it is best to ensure that each device works independently. This will reduce troubleshooting if a discrepancy occurs.
2. Prior to installing any equipment in either new or existing circuits, ensure correct line voltage and line stability. Always remember to shut the power OFF before performing circuit wiring.

5 Installation / Wiring / Setup

1 Installation

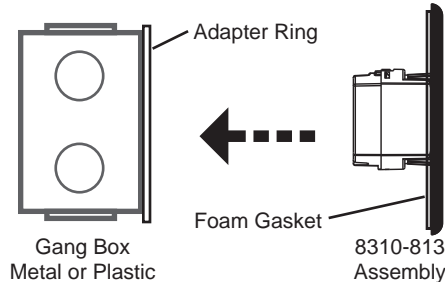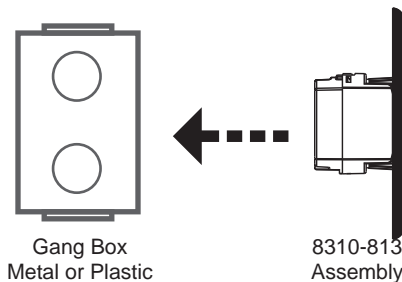


1. The Touchless Actuator may be mounted in conventional metal or plastic electrical gang boxes. Make sure the unit sensor does not come in contact with the metal gang box to avoid shorting out the unit.

- Do not place the sensor in the door's opening range, where the sensor may see door movement.
- Do not place moving objects in front of the sensor.

2. Depending on the door installation, the weather resistant foam gasket or the plastic adapter ring may be used. The weather resistant foam is used as a protective barrier against the elements. The plastic adapter ring is designed to enable the double gang face plate to attach to various plastic and metal gang boxes.

2 Wiring

SEE APPENDIX FOR WIRING DIAGRAMS


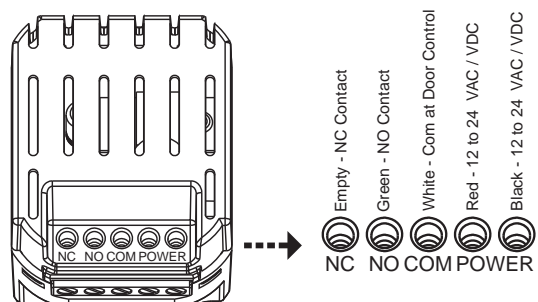


1. Wire the 4-conductor cable to the door operator according to manufacturer specifications.

2. Attach the 4-conductor cable connector to the Touchless Actuator.

5 Installation & Wiring (Cont'd)

3 Setup

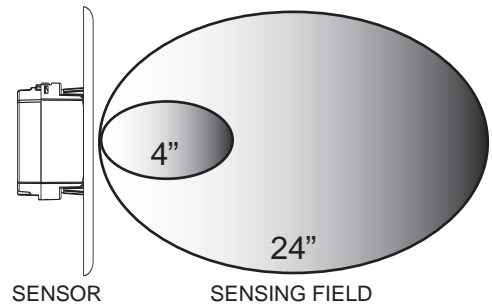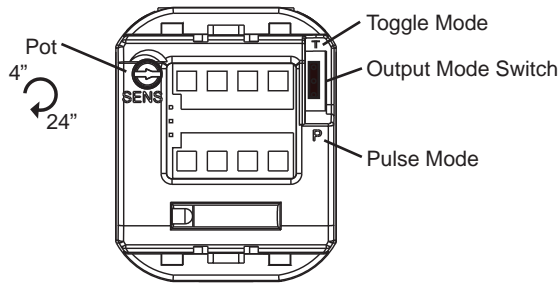

1. Adjust unit to desired setup. Two adjustments can be made to the sensor. The Potentiometer is used to adjust the size of the units' sensing field and the Output Mode switch is used to select Toggle or Pulse mode.
2. Rotate potentiometer clockwise to increase the sensing field. It may be adjusted from 4" to 24".

2. Adjust Output Mode by moving switch in the up position (Toggle Mode) or in the down position (Pulse Mode).

Toggle Mode: Recommended for switch applications. In Toggle mode a detection activates the relay and a second detection deactivates the relay.

Pulse Mode: Recommended for automatic door applications. In Pulse mode a detection activates the relay for a short period of time - depending on the duration of movement in front of door.

6 Troubleshooting

1 Troubleshooting Procedures

| PROBLEM | PROBABLE CAUSE | CORRECTIVE ACTION |
|--|---|--|
| Door does not open when swiping hand in front of sensor. | <ol style="list-style-type: none"> 1. Bad or no power supply. 2. Detection range is too small 3. Wrong connection. | <ol style="list-style-type: none"> 1. Check power supply. If LED switches on or flashes, power connections are OK. 2. Adjust the detection range. Remove any metal plates in front of sensor. 3. Check wiring and relay connection. |
| Door remains permanently open. | <ol style="list-style-type: none"> 1. Environmental conditions are influencing the sensor. 2. Wrong connection. | <ol style="list-style-type: none"> 1. Remove any moving objects close to the sensor. 2. Check wiring and relay connection. |
| The door remains open after detection/activation. | <ol style="list-style-type: none"> 1. Wrong output mode. 2. Wrong connection. | <ol style="list-style-type: none"> 1. Switch the output mode to Pulse mode. 2. Check wiring and relay connection. |

12 Company Contact

LCN



Do not leave problems unresolved. If a satisfactory solution cannot be achieved after troubleshooting a problem, please contact LCN at 1-800-526-2400. If you must wait for the following workday to call LCN, leave the door inoperable until satisfactory repairs can be made. Never sacrifice the safe operation of the automatic door or gate for an incomplete solution.

For more information, visit www.lcn.ingersollrand.com.

FCC APPROVAL

This device complies with Part 15 of the FCC Rules and with RSS-210 of Industry Canada. Operation is subject to the following two conditions:

*this device may not cause harmful interference, and
 *this device must accept any interference received, including interference that may cause undesired operation.

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:


*Reorient or relocate the receiving antenna
 *Increase the separation between the equipment and receiver
 *Connect the equipment into an outlet on a circuit different from that to which the receiver is connected
 *Consult the dealer or an experienced radio/TV technician for help

WARNING: CHANGES OR MODIFICATIONS TO THIS EQUIPMENT NOT EXPRESSLY APPROVED BY BEA INC. MAY VOID THE FCC AUTHORIZATION TO OPERATE THIS EQUIPMENT.


Appendix - Wiring Diagram

8310-813 TOUCHLESS ACTUATOR SINGLE DOOR WIRING


4630/4640 SERIES
ELECTRIC AUTO-EQUALIZER

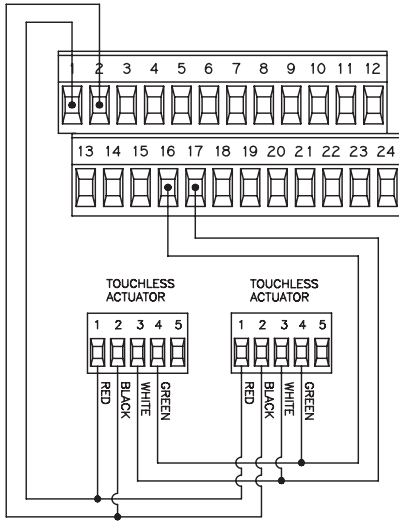

7900 SERIES
PNEUMATIC AUTO-EQUALIZER

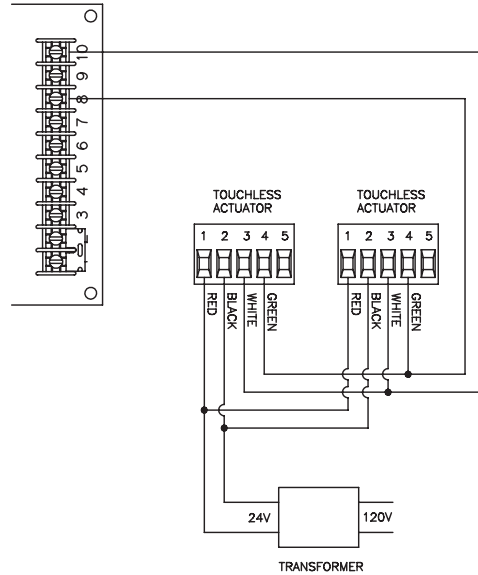

9100 SERIES
BENCHMARK

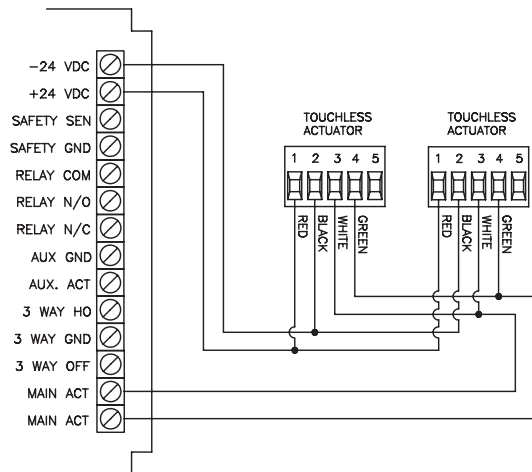

SENIOR SWING - 2800/9500 SERIES
MID SWING - 2900/9700 SERIES

